AIA FILE

#

SPEC #

Models: AP24BC250-3

/ AP40BC350-3

**ISTED** 

## BLAST CHILLERS (Roll-In, Remote Refrigeration) Models: AP24BC250-3 / AP40BC350-3

## SPECIFICATIONS

**SCOPE:** This specification covers the models AP24BC250-3 and AP40BC350-3 HurriChill<sup>™</sup> Blast Chillers. They are complete with all required controls and accessories. Remote condensing unit sold separately. Several options are also available.

**GENERAL:** The microprocessor control system provides a choice of operating cycles: soft chilling, hard chilling, holding, sterilizing, and defrost. One core temperature probe is provided for accurate control of temperature within the product. An optional strip recorder provides a record of the unit's operating parameters during the cycle and the following holding period. The information recorded includes date, time, cycle identification, product identification and product core temperature at prescribed intervals. Models AP24BC250-3 and AP40BC350-3 are each sized for one mobile rack (not included) holding up to (40) 12" x 20" x 2-1/2" deep food pans or up to (20) 18" x 26" sheet pans. Pass-thru models are available as an option.

**PERFORMANCE:** Blast chilling (soft or hard) lowers the food core temperature from 160°F to 38°F within 90 minutes. Chilling times will vary somewhat, depending on the food quantity, initial temperature, density, moisture content, specific heat, and type of container. The airflow has a high velocity, indirect pattern designed to cool all levels at identical rates. Time/temperature chilling rates meet or exceed all FDA and state regulations.

**CONSTRUCTION:** The chilling cabinet is constructed of polished type 304 stainless steel, with 3-1/4" of CFC-free, high density polyurethane insulation. The interior corners are fully rounded. The door is equipped with a removable magnetic gasket. All motors are sealed ball bearing wash-down type. The cabinet floor is insulated (1/2" CFC-free high density polyurethane) and is provided with an integral 3" long ramp to facilitate access. A minimum 15" clear space is required above the cabinet for service. A minimum 6" clear space is required on the control panel side of the cabinet for service. A minimum 12" clear space is required on the hinge side of the cabinet for door opening.

**REFRIGERATION SYSTEM:** The cabinet refrigeration system is complete with all components, including controls, evaporator and blower system. The evaporator is of the forced convection type and designed specifically for blast chilling operation. Air circulation motors, multi-fin and tube type coils, and fan guards are contained within the cabinet. Also included in the cabinet are the liquid line solenoid valve, thermostatic expansion valves, the inlet and outlet connections, and a drain connection. Access to the evaporator for cleaning shall be via a convenient hinged, swing-out ventilator panel. Fan motors have inherent overload protection and the fan blades are guarded to prevent injury.

**MICROPROCESSOR CONTROL SYSTEM:** The solid state electronic control panel is user friendly, easy to reach, and can be set for automatic or manual operation. The food probe continuously measures the product temperature during the chilling cycles. Easy to read VFD display and buzzer alarm are standard features. All settings are programmable by the operator. The standard operating cycles include the following:

Soft Chilling: The air temperature is held in the range of 28°F to 35°F, ideal for delicate food items. The chilling cycle is completed when the food core temperature reaches 38°F to 40°F. JOB \_\_\_\_\_

ITEM #

QTY. REQUIRED



- □ Hard Chilling: The air temperature is lowered to 10°F. When the food core temperature reaches 60°F, the air temperature rises to a range of 28°F to 35°F. The chilling cycle is completed when the food core temperature reaches 38°F to 40°F.
- □ **Thawing (Optional):** Air temperature is carefully monitored and alternates between gentle heat and refrigeration to safely thaw food product.
- □ **Holding:** At the end of any cycle (soft chilling or hard chilling), the unit will automatically switch to a holding mode which will keep the food at 38°F until the cycle is stopped.


## ADDITIONAL FEATURES:

- □ **Defrost:** An automatic defrost cycle is factory preset and will initiate after each 24 hours of operation. A manual defrost override can be selected at any time at the user's discretion.
- □ Batch Names: Store up to 150 batch names that can be used to help identify cycle runs within HACCP reports.

ANSI/NSF 7



American Panel Corporation | 5800 S.E. 78th Street, Ocala, Florida 34472-3412 | Phone: 1-800-327-3015 • (352) 245-7055 | Fax: (352) 245-0726 www.hurrichill.com

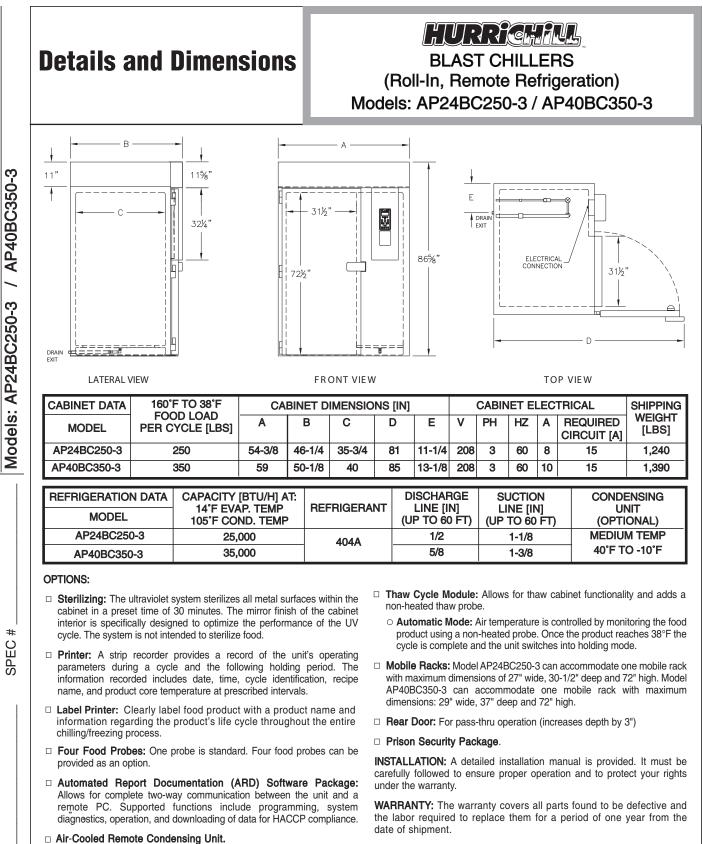

Water-Cooled Remote Condensing Unit.

## American Panel

#

BLAST CHILLERS (Roll-In, Remote Refrigeration)

American Panel Corporation | 5800 S.E. 78th Street, Ocala, Florida 34472-3412 | Phone: 1-800-327-3015 • (352) 245-7055 | Fax: (352) 245-0726 www.hurrichill.com