




Over 90 Years Of Quality Foodservice  
Products And Service

Job \_\_\_\_\_ Item No. \_\_\_\_\_

## Canopy Ventless Hoods

MODELS ☐ WVC-46 ☐ WVC-46X

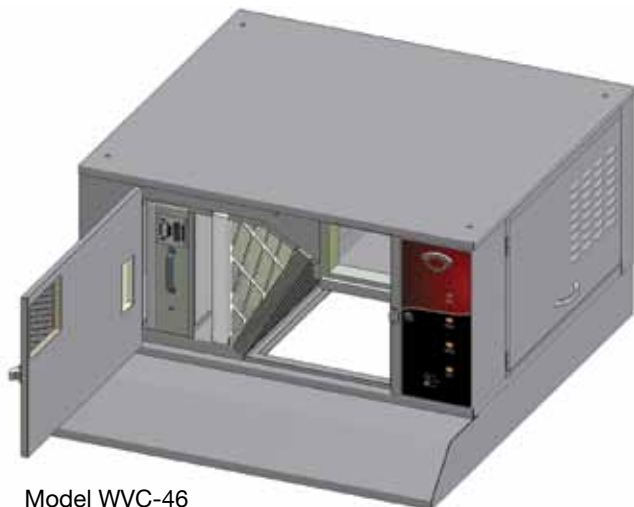

Model WVC-46

### DESCRIPTION

Wells Canopy Style Hoods are Certified Type-1 compliant, UL710B approved recirculation hood systems and feature completely self-contained air filtration system. Canopy-style hoods are available with or without completely self-contained fire-suppression systems. They do not require venting outside making it possible to cook in non-traditional locations or when traditional Type-1 hoods and duct-work are impractical, restricted or too expensive. Operators can use single or double deck electric convection ovens, conventional ovens, combi ovens, cook & hold ovens, steamers and oven proofer combination ovens.

### SPECIFICATIONS

**Fire Protection** – WVC hoods are ANSUL® ready and include heat sensors and an ANSUL nozzle in the plenum. The WVC-46 includes on-board, self-contained fire prevention including the ANSUL tank, and is ready for the ANSUL representative to provide the sopanifier, nitrogen cartridge and to activate and tag the system. The WVC-46X is designed to be connected to an external ANSUL system (not included). A manual fire-pull may be provided by a licensed ANSUL representative and mounted at point of egress. Side access is provided for easy system maintenance. Fire protection system meets NFPA 96 Chapter 13. Fire protection system must be charged and certified by ANSUL Authorized distributor after installation and before first use (operator's responsibility).

**Filtration** – Completely self-contained filtration process reduces emissions below that allowed in NFPA 96 and ANSI UL710B using the EPA 202 test method and includes stainless steel grease baffle filter with grease cup, fiberglass pre-filters, HEPA (High-Efficiency Particulate Air) filter/ carbon-charcoal filter pack. All filters are easily removable with out tools. Air flow sensors continually monitor air flow optimizing performance and grease removal while an interlock system will not allow cooking appliances to function if filters are missing, clogged or in the event of a fire.

**Cooking Appliances** – Only electrically heated appliances are acceptable for installation. Cooking equipment is optional from Wells or other manufacturers. Appliances must be installed as per manufacturers instructions and controlled thru the hood equipment shut-off interface through a customer supplied contactor which will disable cooking equipment in the event of fire or hood malfunction. For size, temperature and KW limits see back page or manual.

**Exhaust and Air Flow** – Exhaust air is directed horizontally. Typical airflow is 850 CFM. A minimum of 150 cubic feet of fresh air per minute is required both in and out of the cooking areas to ensure the dilution of cooking aromas.

### STANDARD FEATURES

- ☐ Completely self-contained, 4-stage filtration system
- ☐ Wall or ceiling mounted
- ☐ Adjustable height as required
- ☐ Very quiet with only 42 dBA average
- ☐ Interlock system will disable cooking appliances if filters are missing, clogged or in the event of a fire
- ☐ Airflow sensors continually monitor airflow for optimizing performance and grease removal
- ☐ Illuminated early-warning system to monitor filter replacement
- ☐ Completely self-contained filtration process reduces emissions below that allowed in NFPA 96 and ANSI UL710B using the EPA 202 test method
- ☐ Stainless steel construction for strength, durability and ease of cleaning
- ☐ Fits through a 36" wide door opening
- ☐ Canopy style systems are movable making them ideal for leased properties
- ☐ Available in 208/240V, 1Ø
- ☐ **Limited two-year parts and one year labor warranty**

### OPTIONS & ACCESSORIES

- ☐ Pre-filters
- ☐ HEPA / carbon-charcoal filter packs
- ☐ Round exhaust duct adapter for remote exhaust flue
- ☐ Optional self-contained ANSUL fire protection system



STD 2



UL 710B

Sheet No. WELLS-WVC-46\_06/13



**Wells Bloomfield** • 10 Sunnen Dr. St. Louis, MO 63143 U.S.A.

Phone : (314) 678-6314 • Fax (314) 781-3636

www.wellsbloomfield.com © 2012 Wells Bloomfield • Printed in the U.S.A.

**NOTE:** Specifications are subject to change without notice and are not intended for installation purposes. See installation instructions prior to installing the unit.



Over 90 Years Of Quality Foodservice  
Products And Service

# Canopy Ventless Hoods

MODELS □ WVC-46 □ WVC-46X


COVERAGE PARAMETERS	MAXIMUM KW/FT	MAX COOKING TEMPERATURE	MAXIMUM SINGLE COOKING AREA (FT <sup>3</sup> )	DIM A MINIMUM NOTE (1)	DIM A MAXIMUM NOTE (2)	DIM B MINIMUM NOTE (3)	DIM C MAXIMUM NOTE (4)	DIM D MAXIMUM NOTE (5)
APPLIANCE TYPE								
OVEN	N/A	550	19	1"	6"	3"	0"	8"
DOUBLE STACK OVEN	N/A	550	19	1"	6"	3"	0"	8"
CONVECTION OVEN	N/A	550	19	1"	6"	3"	0"	8"
STEAMER/COMBI OVEN	N/A	550	19	1"	6"	3"	0"	8"

1. DIM "A" MINIMUM DISTANCE FROM THE LOWER EDGE OF THE HOOD SKIRT AND THE TOP OF THE APPLIANCE.
2. DIM "A" MAXIMUM DISTANCE FROM THE LOWER EDGE OF THE HOOD SKIRT AND THE TOP OF THE APPLIANCE.
3. DIM "B" MAXIMUM OVERHANG BETWEEN THE HOOD SIDE SKIRT AND THE APPLIANCE SIDE.
4. DIM "C" MAXIMUM SPACE BETWEEN THE HOOD REAR SKIRT AND THE BACK PANEL OF THE APPLIANCE.
5. DIM "D" MINIMUM OVERHANG BETWEEN THE FRONT LOWER EDGE OF THE HOOD TO THE DOORS OF THE COOKING APPLIANCE.

THE HOOD AND ALL UNDER HOOD APPLIANCES MUST BE INSTALLED IN ACCORDANCE WITH THE STANDARD FOR VENTILATION CONTROL AND FIRE PROTECTION OF COMMERCIAL COOKING OPERATIONS NFPA 96, THE NATIONAL ELECTRIC CODE NFPA 70 AND ALL LOCAL CODES WHERE APPLICABLE.

ALL UNDER HOOD APPLIANCES MUST BE CONTROLLED BY THE EQUIPMENT SHUTOFF INTERFACE. SEE OWNERS MANUAL AND WIRE DIAGRAM IN SUPPLY CONNECTION BOX. ONLY ELECTRICALLY HEATED APPLIANCES ARE ACCEPTABLE FOR INSTALLATION. APPLIANCE OPERATION REQUIRES THE FIRE SUPPRESSION SYSTEM BE SETUP, CHARGED AND CERTIFIED BY AN AUTHORIZED ANSUL® DISTRIBUTOR. THE AIRFLOW MONITORING SYSTEM WILL PREVENT APPLIANCE OPERATION IF INSUFFICIENT AIRFLOW IS DETECTED OR ALL FILTERS ARE NOT IN PLACE. THE SERVICE PANEL MUST BE IN PLACE FOR BLOWER OPERATION.

WELLS MANUFACTURING  
MODEL NO: WVC-46(X),  
LOWER AIR FLOW LIMIT: (625 CFM)  
MAXIMUM MEASURED GREASE EMISSIONS: 0.0003 LB/HR/FT  
ANSI-UL710B RECIRCULATING SYSTEM

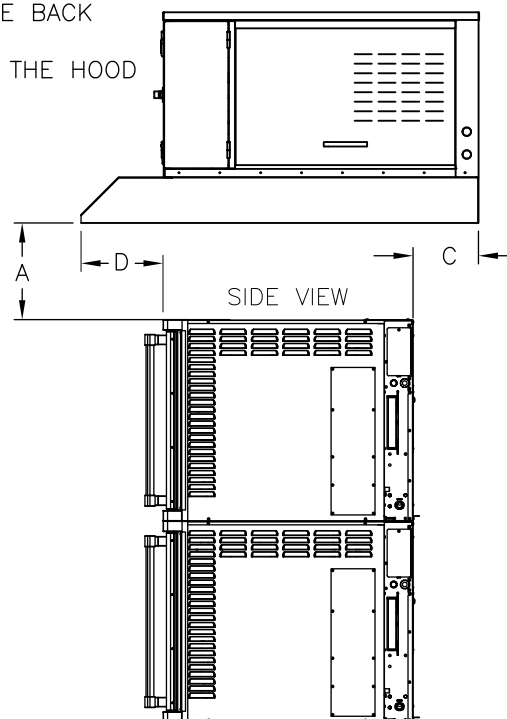

Model Number	W x D x H	Voltage	Horse Power	Amps 1 Phase	Typical Airflow	Max Grease Emissions	Sound Level dBA Average
WVC-46	46.0" x 52.33" x 27.72" 1,168mm x 1,329mm x 704mm	208/240V	1/2	4.3	850 CFM	.0003 LB/HR/FT	42
WVC-46X	46.0" x 52.33" x 27.72" 1,168mm x 1,329mm x 704mm	208/240V	1/2	4.3	850 CFM	.0003 LB/HR/FT	42

Due to periodic changes in designs, methods, procedures, policies and regulations, the specifications contained in this sheet are subject to change without notice. While Wells exercises good faith efforts to provide information that is accurate, we are not responsible for errors or omissions in information provided or conclusions reached as a result of using the specifications. By using the information provided, the user assumes all risks in connection with such use.



**Wells Bloomfield** • 10 Sunnen Dr. St. Louis, MO 63143 U.S.A.  
Phone : (314) 678-6314 • Fax (314) 781-3636  
www.wellsbloomfield.com © 2012 Wells Bloomfield • Printed in the U.S.A.

**NOTE: Specifications are subject to change without notice and are not intended for installation purposes. See installation instructions prior to installing the unit.**